CERTIFICATE OF COMPLIANCE

Issue Date: July 24, 2025 Report No.: LIT15250623MM

Revised: NA

Sangam Baligar
Enphase Energy, Inc.
47281 Bayside Pkwy
Fremont, CA 94538
sbaligar@enphaseenergy.com

Subject: Enphase PV + Battery Energy Storage System UL1741 MM CRD

This is to certify that the above listed product has been investigated by Bureau Veritas in accordance with the Standard(s) indicated in Annex A of this certificate.

Please Note: This certificate does not represent authorization for the use of any Bureau Veritas Certification Marks.

If there are any questions regarding the details contained in this letter, please contact me or any Bureau Veritas CPS customer service representative.

Sincerely,

Aditya Iyer

Aditya Iyer
Principal Engineer
aditya.iyer@bureauveritas.com

Reviewed by,

Dishant Patel

Dishant Patel
Reviewer
dishant.patel@bureauveritas.com

Bureau Veritas Consumer Products Services
1 Distribution Center Circle, Suite #1, Littleton, MA 01460
+1978-486-8880 / cps.bureauveritas.com

ANNEX A: CERTIFICATION STANDARDS

UL 1741 3rd Edition, September 28, 2021, Inverters, Converters, Controllers and Interconnection System Equipment for Use With Distributed Energy

UL 1741 CRD for Clarification of Multi-Mode Inverter Requirements Including Supply Conductor Grounding Dated April 7, 2023

ANNEX B: COMPLIANCE DETAILS

Compliance with this includes Backfeed Protection and Synchronization between Enphase Systems and Area EPS/AC utility systems.
The MM CRD evaluation was conducted on a representative Enphase Energy System and the certification applies to the following configuration.

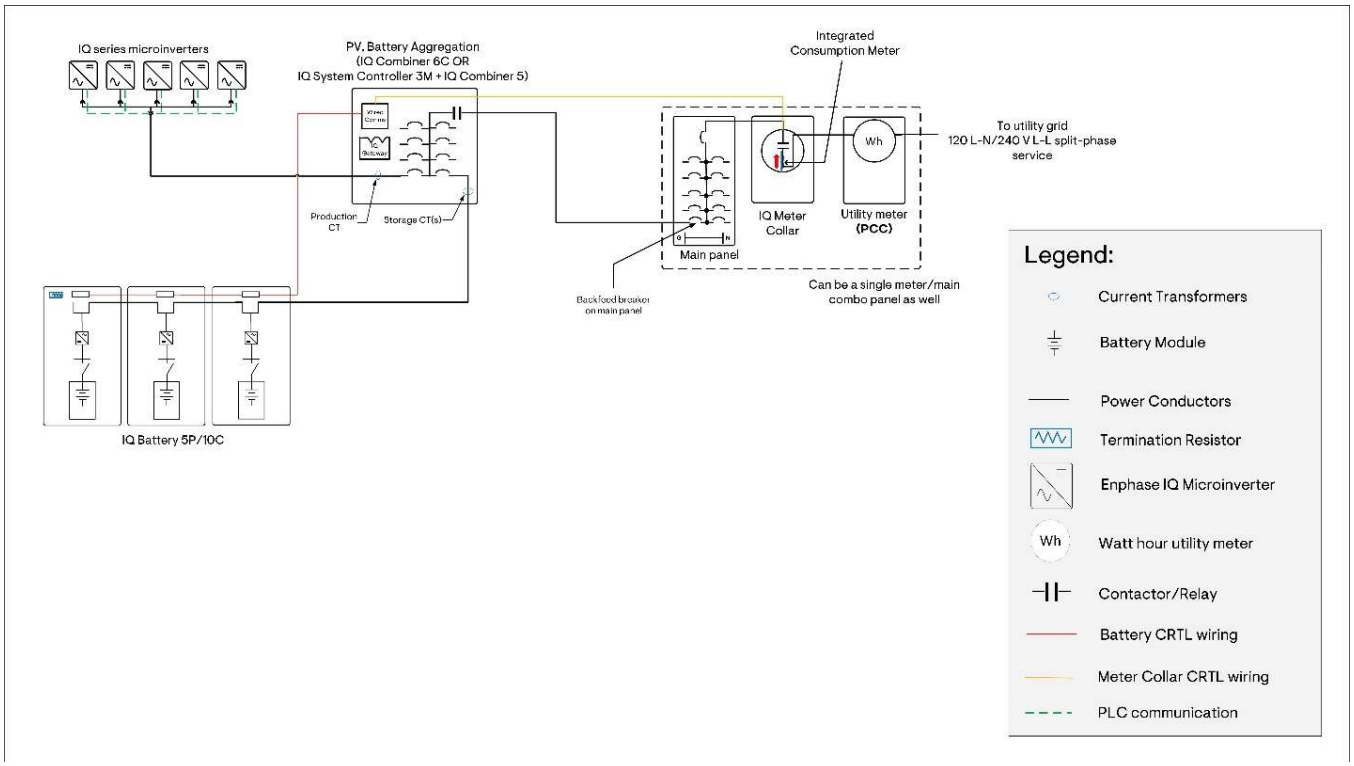

Bureau Veritas Consumer Products Services
1 Distribution Center Circle, Suite #1, Littleton, MA 01460
+1978-486-8880 / cps.bureauveritas.com

System Configuration:

Product	Models	Description
IQ Collar	MC-200-011-V01	Meter Socket Adapter HRT Firmware Version: 1.7.0 (c504e8f6920ce3110a99a9ca2d775903a7ee3200885c52239ea353396545a39b)
IQ Battery 10C	IQBATTERY-10C-1P-NA	The IQ Battery 10C system with two 5 kWh battery units having integrated IQ Microinverters with a battery management system (BMS) as part of IQ Microinverters. HRT Firmware Version: 4.4.37 (0a302e4cbfda15295433a9fb1891b5434721e8c6)
IQ Combiner 6C	X-IQ-AM1-240-6C	Integrated combiner controller board and IQ Gateway HRT Firmware Version: 1.02 (adb69428)
Enphase PV	IQ Series	Enphase Microinverters with latest firmware

END

Bureau Veritas Consumer Products Services
1 Distribution Center Circle, Suite #1, Littleton, MA 01460
+1978-486-8880 / cps.bureauveritas.com